


EXCEPT AS OTHERWISE PROVIDED BY CONTRACT, THIS DRAWING AND SPECIFICATIONS SHALL NOT BE REPRODUCED, COPIED OR USED AS THE BASIS FOR MANUFACTURE OR SALE OF MATTER DEPICTED HEREIN WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE CLAUDE LAVAL CORPORATION, OR ITS ASSIGNEES.

REVISIONS				
ZONE	REV.	DESCRIPTION	DATE	APPROVED

- NOTES:
1. OUTLET: 4" FNPT.
  2. RATED FLOW: 48-99 gpm (11-22.5 m<sup>3</sup>/hr).
  3. MINIMUM WELL I.D.: 6" (153 mm).
  4. MINIMUM SUBMERGENCE: 30 ft (9.2 m)
  5. APPROXIMATE DRY WEIGHT: 9.8 lbs (4.4 kg).
  6. IF UNIT IS NOT DIRECTLY CONNECTED TO PUMP INTAKE, SHROUD OR PACKERS ARE REQUIRED.

THIS DRAWING HAS BEEN GENERATED AND IS MAINTAINED BY A CAD SYSTEM. CHANGES SHALL ONLY BE INCORPORATED AS DIRECTED BY AN APPROVED ENGINEERING CHANGE ORDER (ECO). PAPER COPIES ARE UNCONTROLLED.

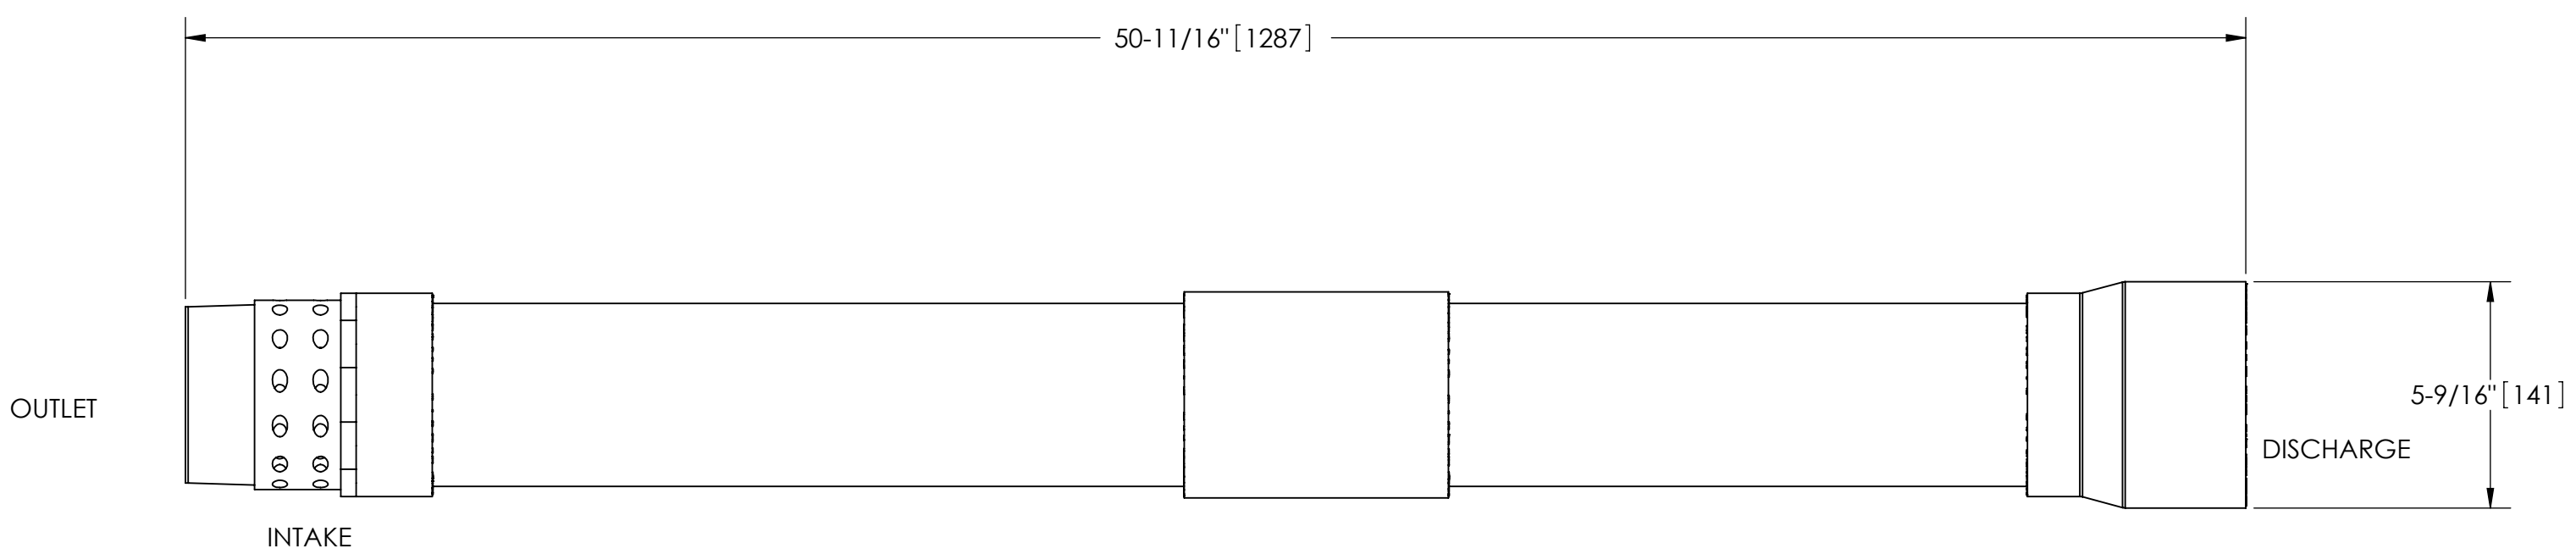

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN: INCHES [mm] TOLERANCES ARE:		ENGINEERED FOR: <b>STANDARD</b>		CLAUDE LAVAL CORP. FRESNO, CALIFORNIA 93727 WWW.LAKOS.COM		LAVAL UNDERGROUND SURVEYS	
FRACTIONS ± 1/2"	DECIMALS .XX ± .01 .XXX ± .005 .XXXX ± .0005	ANGLES ± 1/4°	APPROVALS	DATE	TITLE <b>SUB-99, SEPARATOR, SUB 99 TURBINE, ABS/PVC</b>		
DO NOT SCALE DRAWING			DRAWN JBI	6/30/08	SIZE C		
MATERIAL ABS/PVC			ENGR JBI	6/30/08	MODEL NO.	DWG NO. <b>125587</b>	REV. A
FINISH NONE			MFG -	-	SCALE 1:4	EST. WT. 9.8 lb	SHEET 1 OF 1
			WORK ORDER	QTY.			

D  
C  
B  
A

D  
C  
B  
A

4

3

2

1

4

3

2

1

DWG NO. 125587  
SHEET 1  
REV. A