



EXCEPT AS OTHERWISE PROVIDED BY CONTRACT, THIS DRAWING AND SPECIFICATIONS SHALL NOT BE REPRODUCED, COPIED OR USED AS THE BASIS FOR MANUFACTURE OR SALE OF MATTER DEPICTED HEREIN WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE CLAUDE LAVAL CORPORATION, OR ITS ASSIGNEES.

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

THIS DRAWING HAS BEEN GENERATED AND IS MAINTAINED BY A CAD SYSTEM. CHANGES SHALL ONLY BE INCORPORATED AS DIRECTED BY AN APPROVED ENGINEERING CHANGE ORDER (ECO). PAPER COPIES ARE UNCONTROLLED.

NOTES:

1. INLET AND OUTLET ARE 1" NPT.
2. MAXIMUM PRESSURE: 150 psi (10.3 bar).
3. PRESSURE LOSS: 5.0-12.0 psi AT RATED FLOW.
4. RATED FLOW: 19-32 gpm (4.5-7.5 m³/hr).
5. APPROXIMATE DRY WEIGHT: 25 lbs (11.3 Kg).

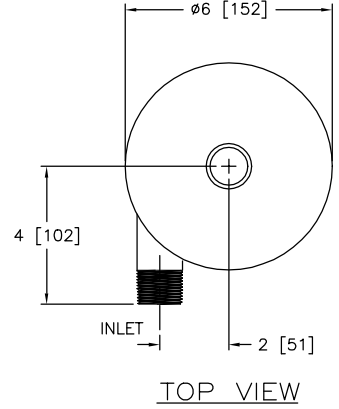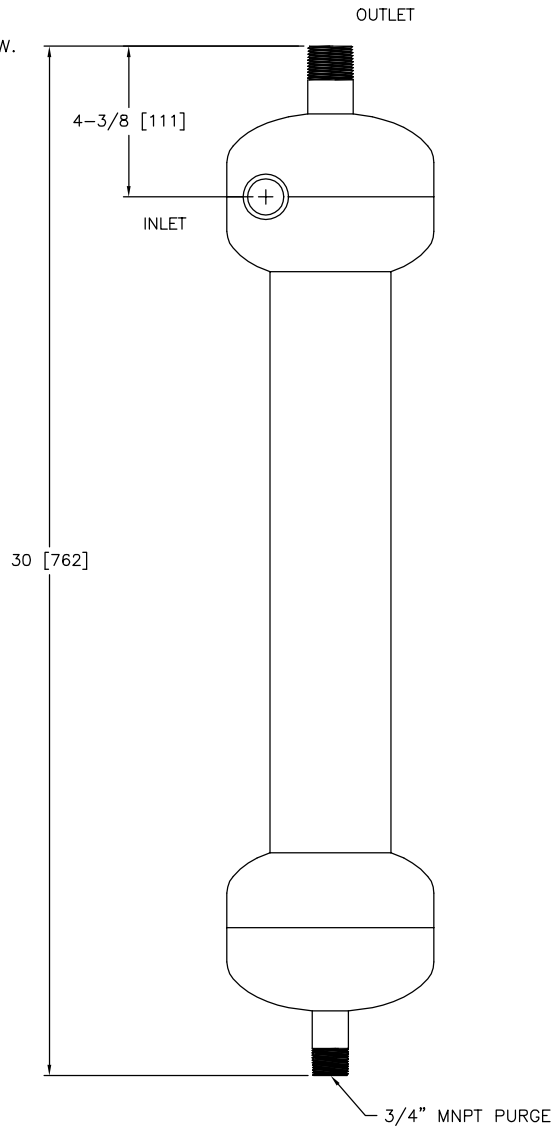

SUBMITTAL DRAWING

This drawing is submitted for spatial consideration only. Do not pre-plumb to these dimensions.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES (mm) TOLERANCES ARE: FRACTIONS DECIMALS ANGLES ±1/4 .005 ±.005 ±1/4		ENGINEERED FOR: STANDARD		CLAUDE LAVAL CORP. 1365 N. CLOVIS AVE. FRESNO, CALIFORNIA 93727			
DO NOT SCALE DRAWING		APPROVALS	DATE	TITLE			
MATERIAL TYPE: 316L STAINLESS STEEL		DRAWN	3/30/97	ILS-0100, SEPARATOR, 1" NPT INLINE, SS 316L			
FINISH GLASS BLAST		REVIEWED		SIZE	MODEL NO.	DWG NO.	REV.
		ENGR		C		100293	-
		WORK ORDER		SCALE	3/8	EST. WT.	SHEET A1 OF A1

100293