

3

4

 \square

| 2 | | | | 1 | | |
|--|------------------|-----|-------------|------|----------|--|
| GENERATED AND IS STEM. CHANGES SHALL AS DIRECTED BY AN CHANGE ORDER (ECO). JNCONTROLLED. | REVISION HISTORY | | | | | |
| | ZONE | REV | DESCRIPTION | DATE | APPROVED | |

NOTES:

- 1. INLET IS 6" PIPE (125# ANSI FLANGED).
- 2. OUTLET IS 4" PIPE (GROOVED).
- PURGE OUTLET IS 1-1/2" PIPE. 3.
- MAXIMUM PRESSURE: 150 psi (10.3 bar). 4.
- MAXIMUM TEMPERATURE: 100°F (37.8°C). 5.
- SPECIFIED FLOWRATE OF 525 gpm (119 m³/hr). 6.
- FINISH: AS ASSEMBLED. 7.
- POWER REQUIREMENT: 460V, 3PH, 60Hz. 8.
- NEMA 4X MOTOR STARTER ENCLOSURE WITH 9. SAFETY DISCONNECT AND H.O.A. SWITCH.
- 10. APPROXIMATE DRY WEIGHT: 1088 lbs (494 kg).
- 11. INLET/OUTLET VALVE KIT, MODEL TCV-0525 RECOMMENDED. 12. MINIMUM PIPE FROM TOWER BASIN TO TC SYSTEM IS 8" PIPE.


D

С

15468

0

- 13. FLOODED SUCTION REQUIRED.
- COMPONENT LIST:
- (1) ELECTRICAL CONTROL BOX 460V 60Hz W/120V TRANSFORMER.
- (2) SEPARATOR: HTX-0285-TC.
- (3) PUMP: 15 HP CENTRIFUGAL, 1750 rpm, 460V, 60Hz.
- (4) INLET/OUTLET PRESSURE GAUGES: 0-100 psi, GLYCERIN-FILLED.
- (5) PURGE EQUIPMENT: SRV-816.
- (6) DIFFERENTIAL PRESSURE INDICATOR:
- (AVAILABLE WITH DRY DRY CONTACT-
- MODEL DHE-15-S. ORDER SEPARATELY).

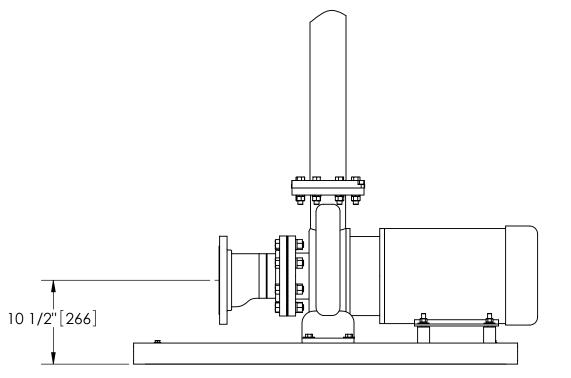

FRONT VIEW PUMP & SPOOL

| UNLESS OTHERWISE SPECIFIED: | ENGINEERED FOR: | | A | | |
|--|-----------------|-------------|--|--|--|
| DIMENSIONS ARE IN: INCHES [mm] TOLERANCES ARE: FRACTIONS DECIMALS ANGLES | STANDARD | | CLAUDE LAVAL CORP. FRESNO, CALIFORNIA 93727 | | |
| ± 1/2" .XX ± .01 ± 1/4° .XXX ± .005 | APPROVALS | DATE | WWW.LAKOS.COM | | |
| .XXXX ± .0005 DO NOT SCALE DRAWING | DRAWN SDF/A | ADJ 5/23/05 | 5 TBX-0525-SRV, TC SYSTEM, | | |
| PER LAKOS SPEC | ENGR ADJ | 10/11/06 | SIDESTREAM HTX-0285, 460V 60HZ DELUXE | | |
| FINISH AS ASSEMBLED | MFG - | - | | | |
| | WORK ORDER | QTY. | C 115468 D | | |
| | | | SCALE 1:12 1088 lb SHEET 1 OF 1 | | |
| 2 | | | 1 | | |