

4

2			1				
INERATED AND IS EM. CHANGES SHALL	REVISION HISTORY						
	ZONE	REV	DESCRIPTION	DATE	APPROVED		
DIRECTED BY AN HANGE ORDER (ECO). ICONTROLLED.							

NOTES:

- 1. INLET IS 2" PIPE (NPT).
- 2. OUTLET IS 1-1/2" PIPE (GROOVED).
- 3. PURGE OUTLET IS 3/4" PIPE.
- MAXIMUM PRESSURE: 150 psi (10.3 bar). 4.
- MAXIMUM TEMPERATURE: 100°F (37.8°C). 5.
- SPECIFIED FLOWRATE OF 65 gpm (15 m³/hr). 6.
- 7. FINISH: AS ASSEMBLED.
- 8. POWER REQUIREMENT: 460V, 3PH, 60Hz.
- 9. NEMA 4X MOTOR STARTER ENCLOSURE WITH SAFETY DISCONNECT AND H.O.A. SWITCH.
- 10. APPROXIMATE DRY WEIGHT: 461 lbs (209 kg).
- 11. INLET/OUTLET VALVE KIT, MODEL TCV-0065 RECOMMENDED.
- 12. MINIMUM PIPE TO TB SYSTEM IS 2-1/2" PIPE.
- 13. FLOODED SUCTION REQUIRED.


COMPONENT LIST:

(1) ELECTRICAL CONTROL BOX 460V 60Hz W/120V TRANSFORMER.

С

- (2) SEPARATOR: HTX-0038-TC.
- (3) PUMP: 1-1/2 HP CENTRIFUGAL, 3500 rpm, 460V, 60Hz.
- (4) INLET/OUTLET PRESSURE GAUGES: 0-100 psi, GLYCERIN-FILLED.
- (5) PURGE EQUIPMENT: SRV-816.
- (6) DIFFERENTIAL PRESSURE INDICATOR: (AVAILABLE WITH DRY DRY CONTACT-

MODEL DHE-15-S. ORDER SEPARATELY)

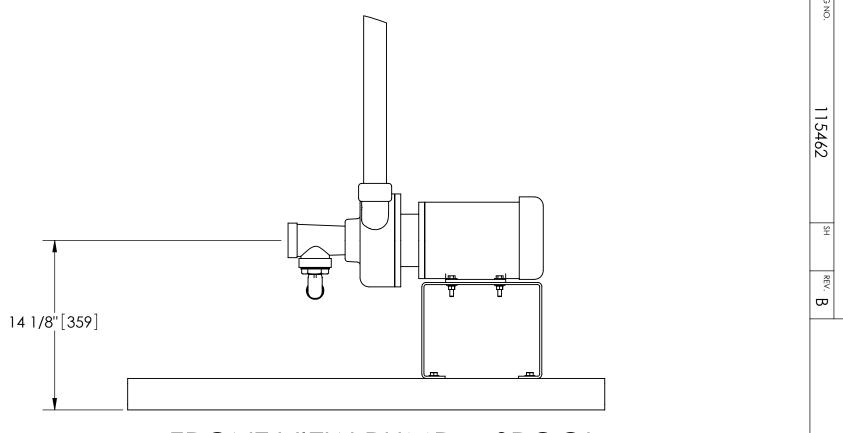

FRONT VIEW PUMP & SPOOL

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN: INCHES [mm]		`			
TOLERANCES ARE: FRACTIONS DECIMALS ANGLES	STANDARD				
$\pm 1/2"$.XX $\pm .01$ $\pm 1/4^{\circ}$.XXX $\pm .005$	APPROVALS	DATE	WWW.LAKOS.COM		
.XXXX ± .0005 DO NOT SCALE DRAWING	DRAWN	5 10 1 10 5			
	. SGF/ADJ	5/24/05	TBX-0065-SRV, TC SYSTEM,		
PER LAKOS SPEC	ENGR HSK	5/24/05	SIDESTREAM HTX-0038, 460V 60HZ DELUXE		
FINISH AS ASSEMBLED	MFG _	-			
	WORK ORDER	QTY.	C 115462 B		
			SCALE 1:8 EST. WT. 461 lb SHEET 1 OF 1		
2			1		

 \square

3